


In the matter of
The 2009 Victorian Bushfires
Royal Commission
and
In the matter of
Powercor Australia Ltd

**SUBMISSIONS ON BEHALF OF POWERCOR AUSTRALIA LTD
FIRE AT WEERITE / POMBORNEIT**

APPENDIX 3

Graph: *CDN to CLC 66kV Line and CDN2 22kV Feeder Operations – 7 Feb 2009*
Exhibit 1 to Witness Statement of Wayne McDonald dated 1 September 2009
WIT.7001.001.0013

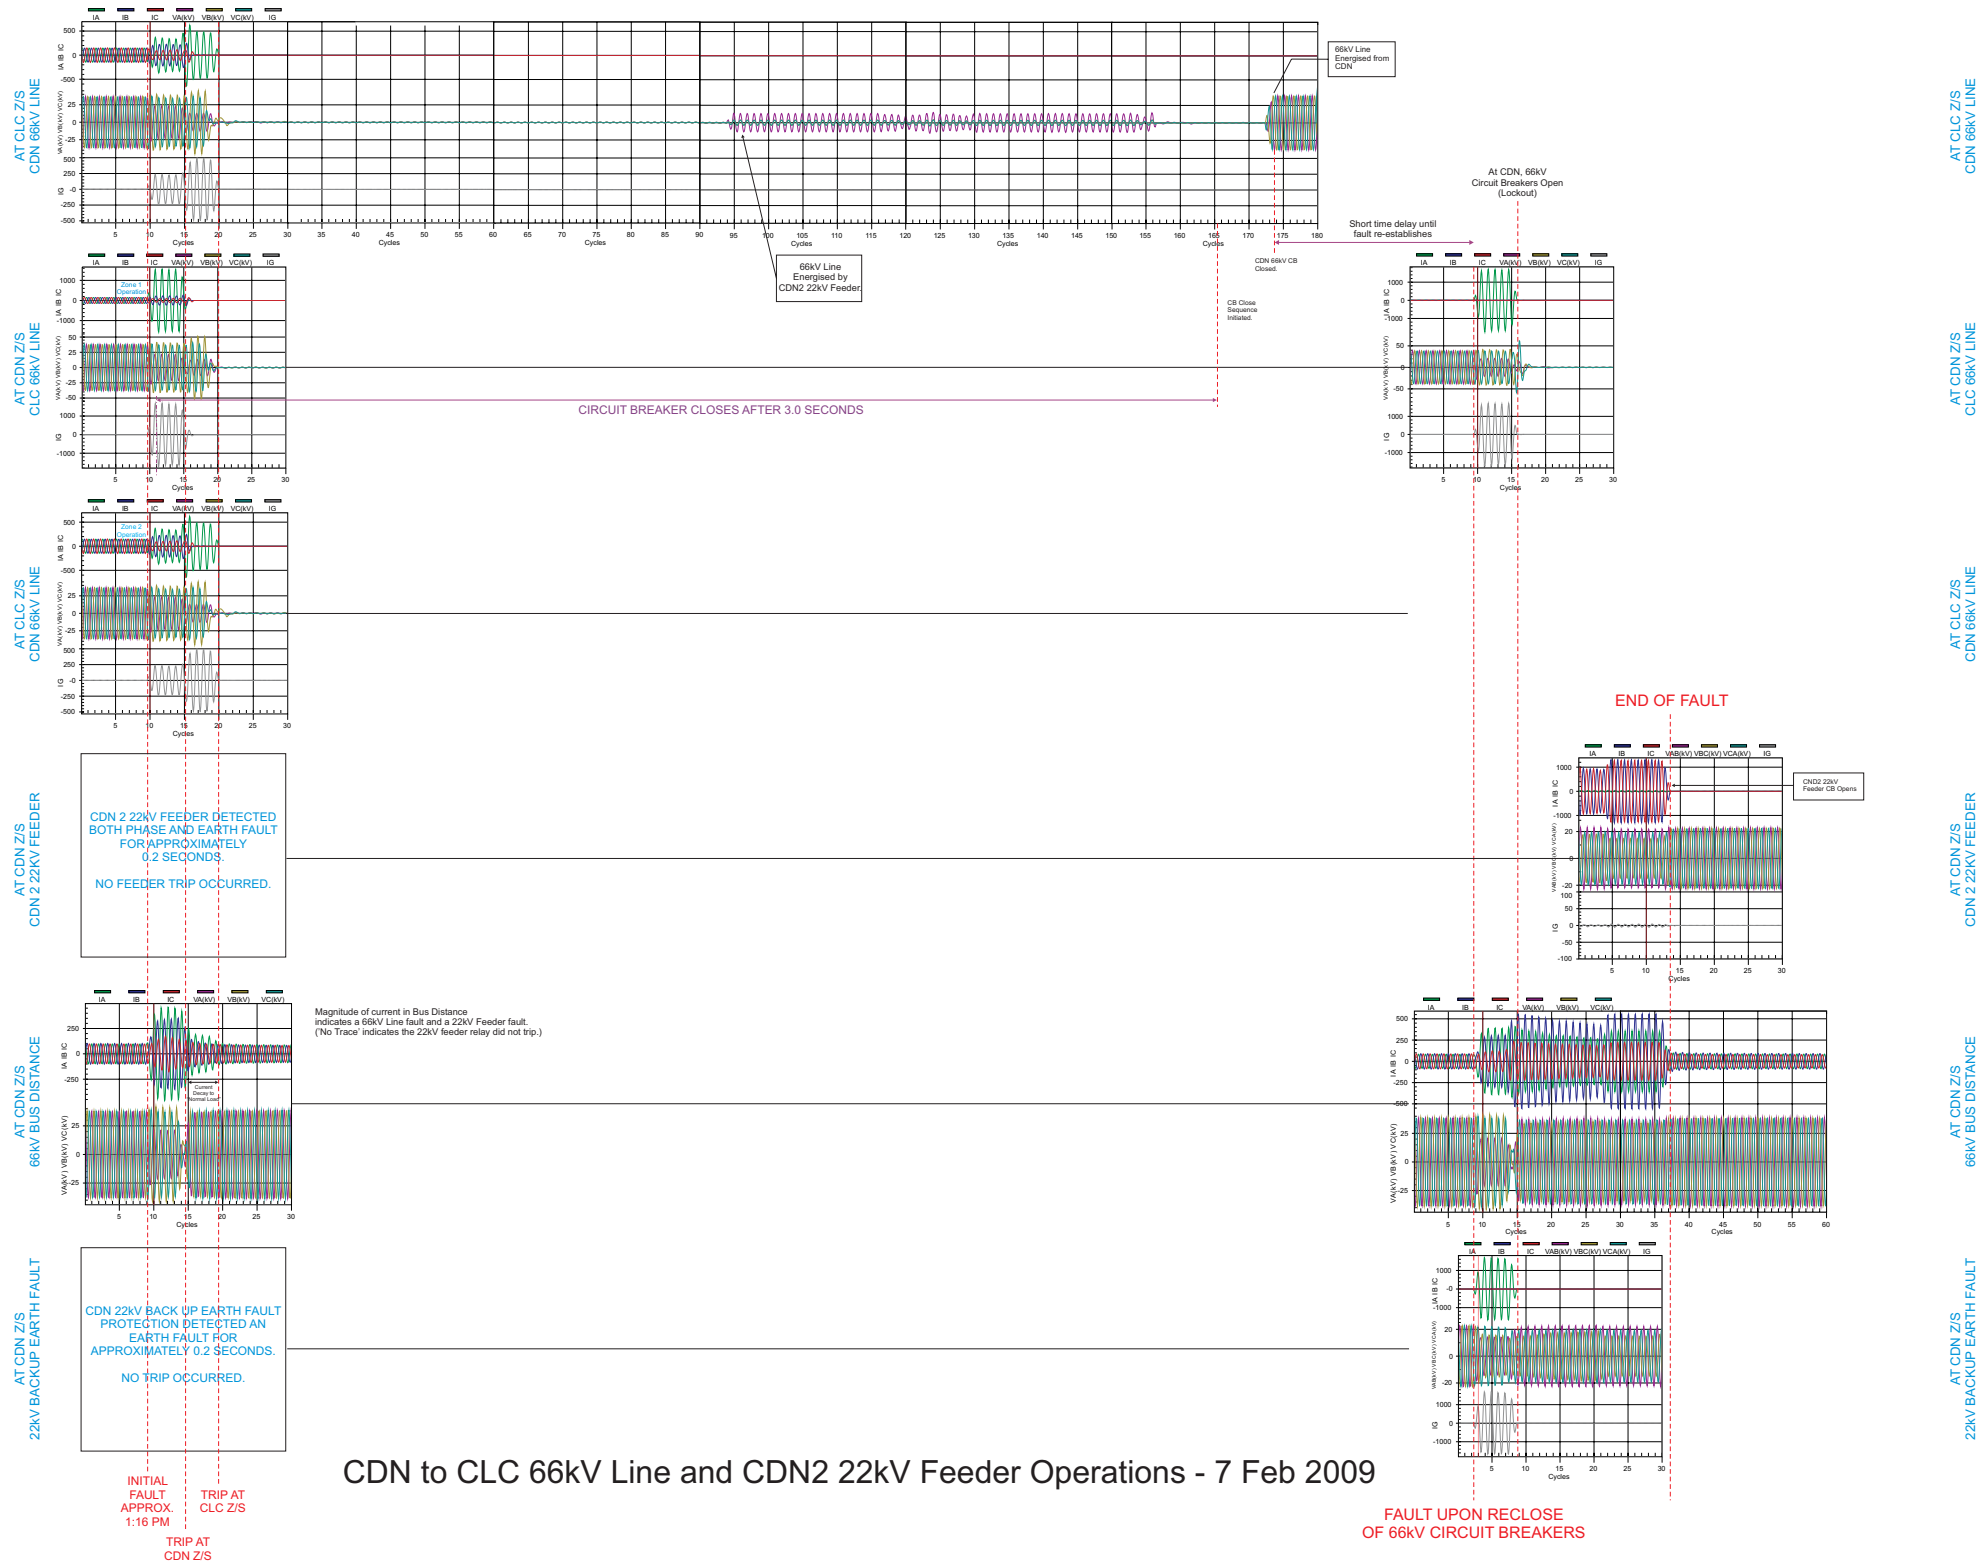

CDN to CLC 66kV Line and CDN2 22kV Feeder Operations - 7 Feb 2009

FAULT UPON RECLOSE OF 66KV CIRCUIT BREAKERS

INITIAL FAULT APPROX 1:16 PM
TRIP AT CLC Z/S
TRIP AT CDN Z/S

AT CLC Z/S
CDN 66KV LINE

AT CDN Z/S
CLC 66KV LINE

AT CLC Z/S
CDN 66KV LINE

AT CDN Z/S
CDN 2 22KV FEEDER

AT CDN Z/S
66KV BUS DISTANCE

AT CDN Z/S
22KV BACKUP EARTH FAULT